


- 2 - 1/4" X 2" BRASS NIPPLES
- 2 - 1/4" X 3/4" BRASS BUSHINGS
- 2 - 3/4" BRASS ELBOWS (FIP X COMP)
- ±5 LF 3/4" COPPER TUBING (TYPE K)
- 5 - 3/4" ADAPTORS (COMP X MIP)
- 1 - 3/4" 180° RETURN BEND (MIP)(GALV)
- 1 - 3/4" BRASS TEE (FIP)
- (CONNECT BLEEDER TO BOTH DRAINS
- 1 - 3/4" X 18" GALV. NIPPLE
- 1 - 3/4" BRASS COUPLING (FIP)

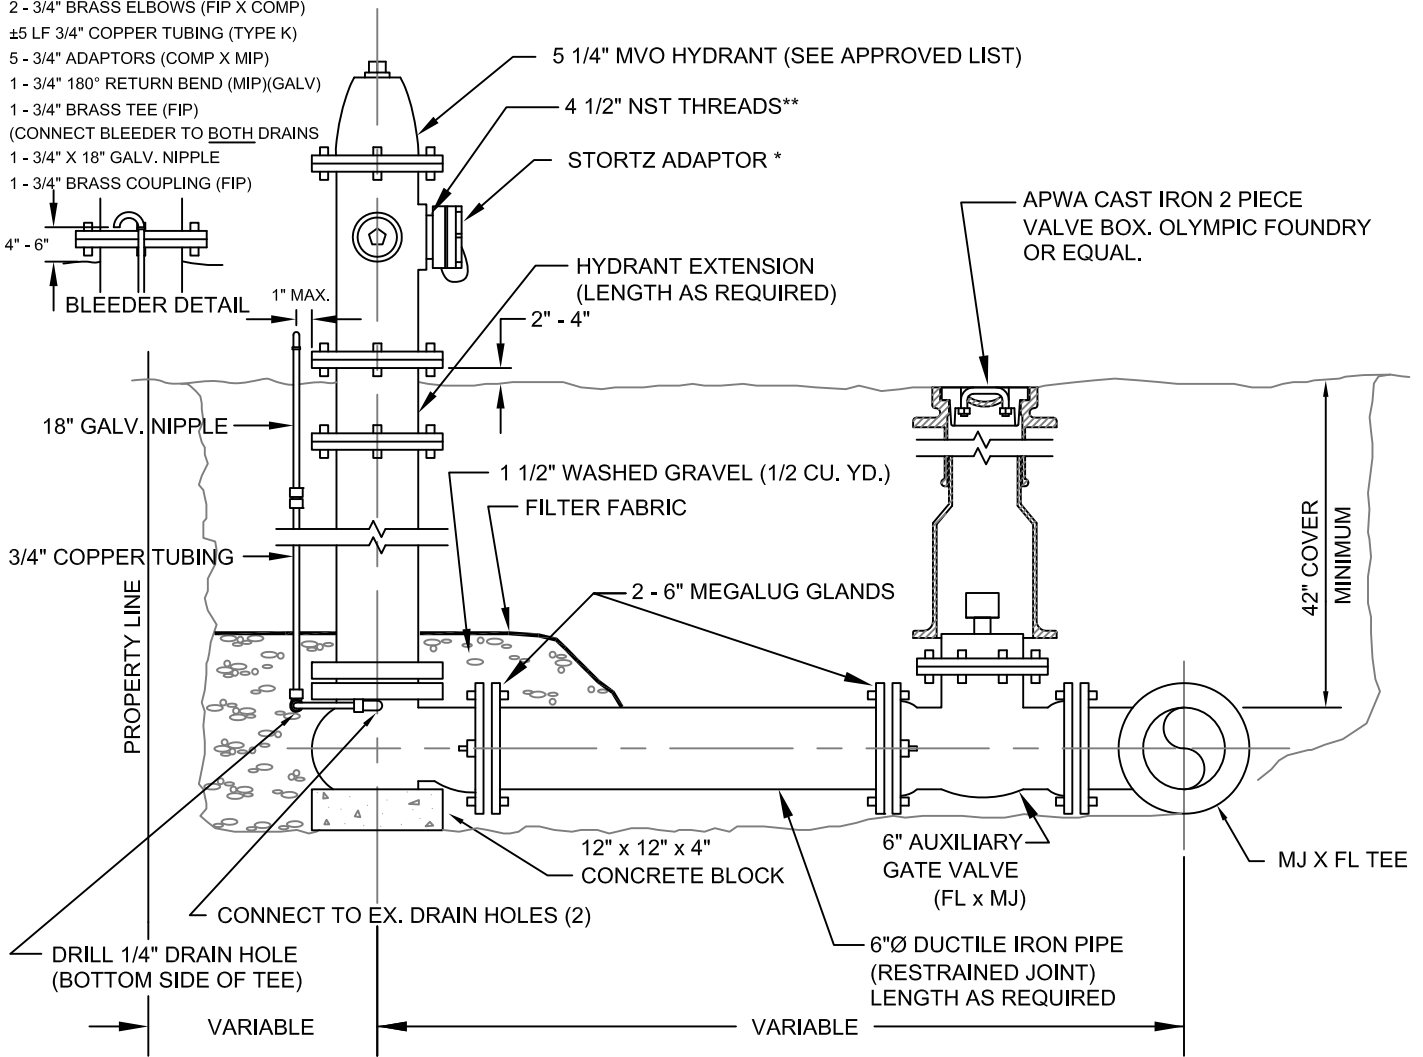

NOTES:

PAINT HYDRANT WITH CASE YELLOW #X3472 AS MANUFACTURED BY FARWEST PAINT MFG. CO.

EXTRUDED CURBING. SEE DETAIL #10.

INSTALL BLUE PAVEMENT MARKER IF HYDRANT IS IN RIGHT-OF-WAY.

NEATLY STENCIL VALVE DISTANCE ONTO HYDRANT W/ 2" NUMERALS USING WHITE OR BLACK ENAMEL PAINT AND FACING THE FOOT VALVE.

BLEEDER KIT AVAILABLE FROM MOST SUPPLIERS.

*** PUMPER PORT REQUIREMENTS:**

5" STORTZ ADAPTOR - FIRE DISTRICT #2, SOUTH KING, CITIES OF SEATAC, TUKWILA & KENT

HWD APPROVED HYDRANTS:

CLOW MEDALLION F-2545
 MUELLER CENTURION A-423

** ALL STORTZ ADAPTORS TO FIT 4 1/2" NST THREADS

HYDRANT INSTALLATION

NTS



REVISION DATE 4/25/13	DRAWN SED	CHECKED JD	DISTRICT APPROVED JD
PLOTTING SCALE NTS	FILE NAME HWD-009.DWG	DATE APPROVED 4/25/13	