


FLUSHING SOURCE
HYDRANT METER REQUIRED

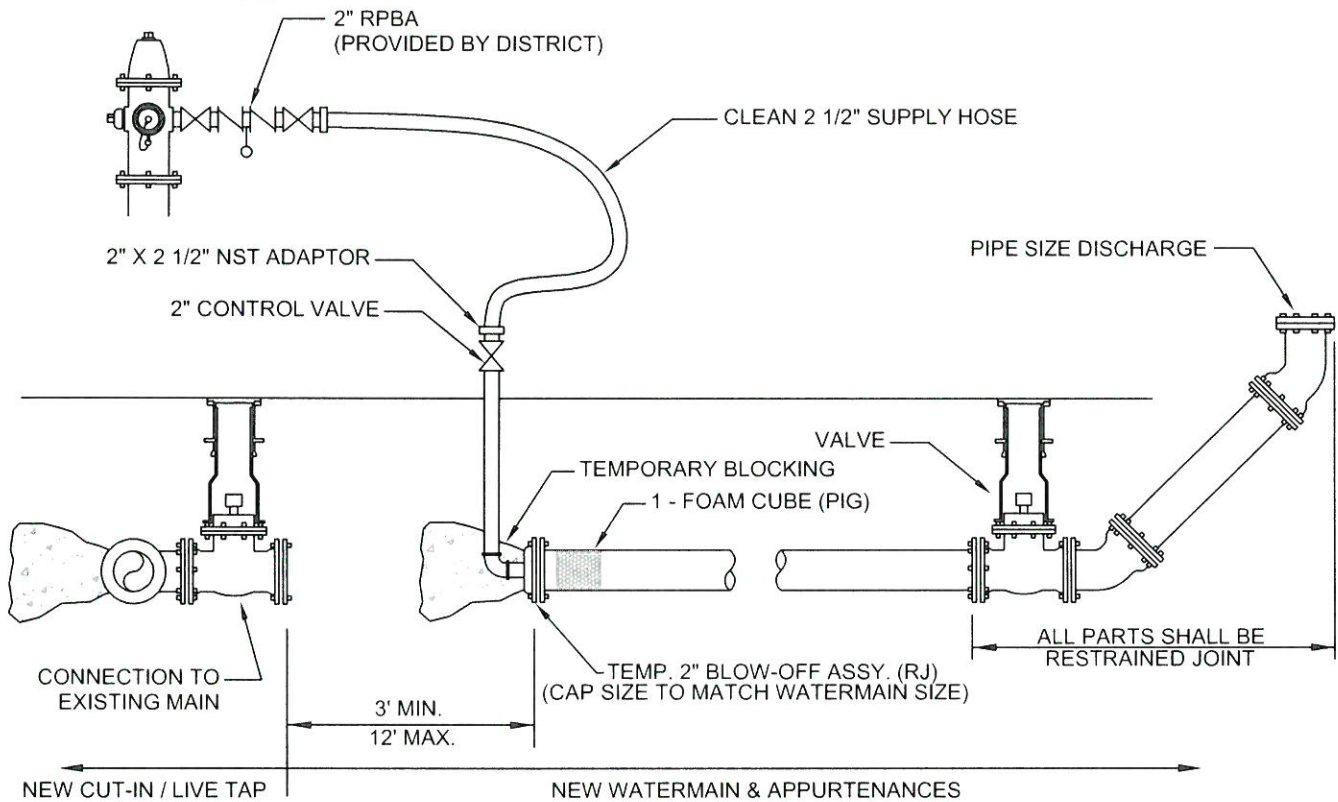

NOTES:

- ALL FITTINGS SHALL BE DUCTILE IRON.
- ALL EXCAVATION SHALL PROVIDE A MINIMUM OF 12" CLEARANCE AROUND PIPE & FITTINGS.
- CONTRACTOR TO DETERMINE ALIGNMENT & GRADE OF EXISTING FACILITIES PRIOR TO INSTALLATION OF NEW WATERMAIN. OUTSIDE DIAMETER OF EXISTING WATERMAIN TO BE DETERMINED AT THE SAME TIME THE CONTRACTOR EXCAVATES FOR ALIGNMENT & GRADE.
- ALL EXCAVATION, PIPE, FITTINGS (EXCEPT AS NOTED), FOAM CUBES (PIGS), OTHER MATERIALS, BACKFILL, COMPACTION & RESTORATION SHALL BE PROVIDED BY THE CONTRACTOR. ALL MATERIALS TO BE ON JOB SITE PRIOR TO SCHEDULED SHUT-DOWN OF EXISTING WATERMAINS.
- D.I. SLEEVE(S) (RJ) TO BE INSERTED AT TIME OF CONNECTION FOR CUT IN TO EXISTING WATERMAIN.
- COORDINATE WITH SEWER DISTRICT BEFORE DISCHARGE INTO SEWERS.
- FITTINGS & HOSE SIZE SHOWN ARE MINIMUM SIZE.

MAIN CLEANING / TESTING / PIGGING FOR CONNECTIONS TO EXISTING WATERMAINS

APPROVAL DATE
10/21/2020

DRAWN
SED

CHECKED
DS

PLOTTING SCALE
NTS

DETAIL NUMBER
HWD STANDARD DETAIL 28

BD
10/28/20

